Diana Akita-Byrd

Birth Plan, Group B Beta Streptococcus Positive

University of Colorado Anschutz Medical Campus

REVISED 2/13/2025

AKITA-BYRD, DIANA
DOB: FEBRUARY 29th 34/F
MRN: 4819593
ALLERGIES: NKA

ORIENTATION

SIMULATION

HFS 4TH FLOOR/ROOM 1

MR#4819593
Tom Slatter, MD

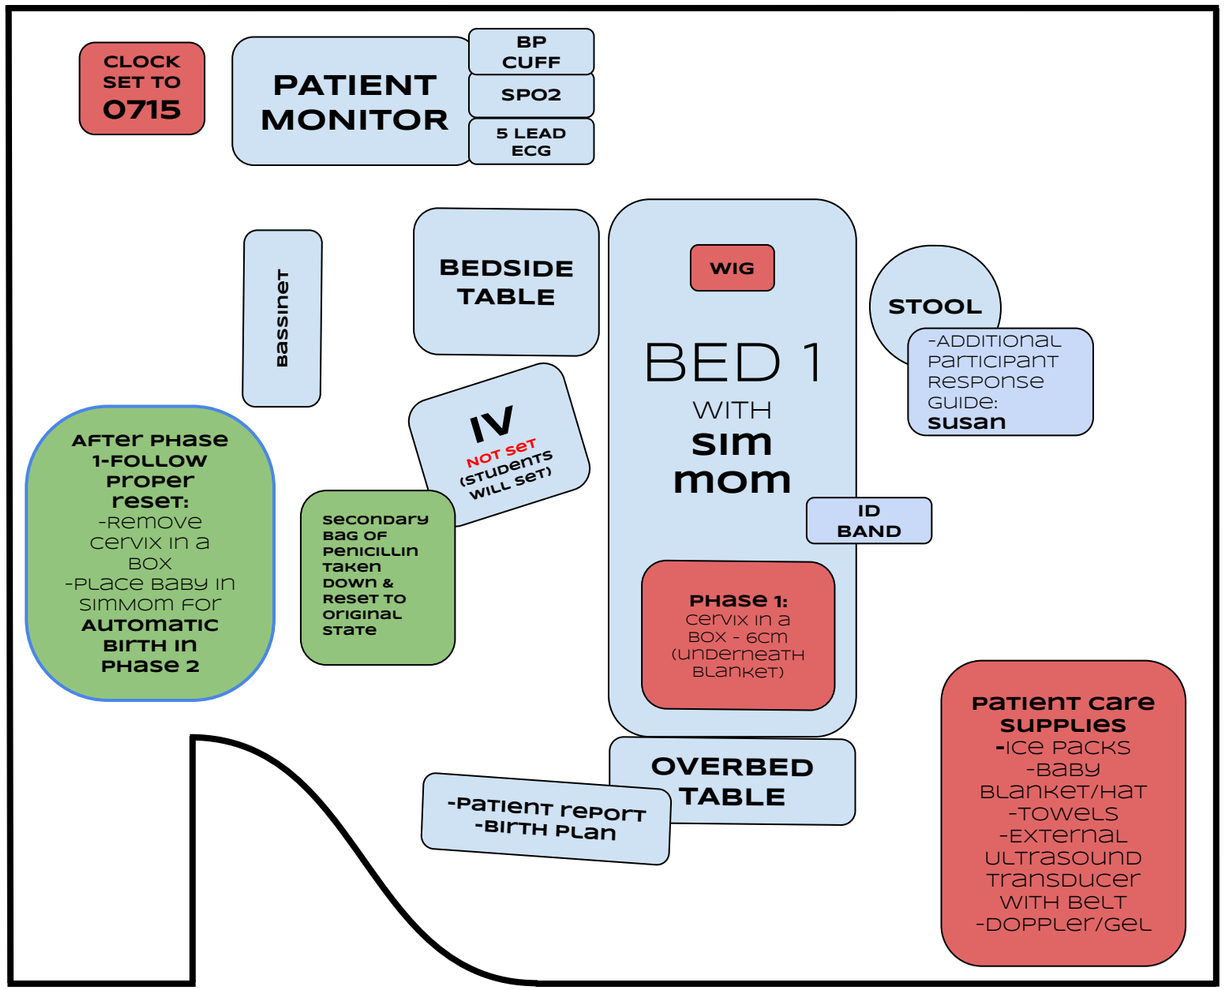

STARTING VITALS

- HR - 84
- SPO2 - 99%
- T - 98.1 F
- RR - 18
- BP - 118/68

ORIENTATION =

SCENE 1 =

SCENE 2 =

control room
instructor laptop

PRINTED MATERIALS
- ALGORITHM QUICK CARD
- SCENARIO SNAPSHOT
- PATIENT RESPONSE GUIDE

OB Session #2 SIM

Birth Plan, Group B Beta Streptococcus Positive

© 2022. THIS WORK IS LICENSED UNDER A CC BY-NC-ND 4.0 LICENSE.

EQUIPMENT

IV PUMP

IV POLE

(2) IV CHANNELS

ID BAND

BASSINET

SWADDLING BLANKET

BABY HAT

External ultrasound transducer with belt and external toco transducer with belt

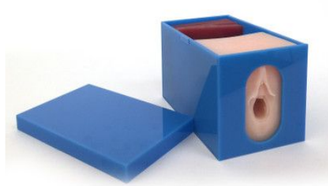

cervix in a box- 6 cm

ICE PACKS

DOPPLER/GEL

TOWELS